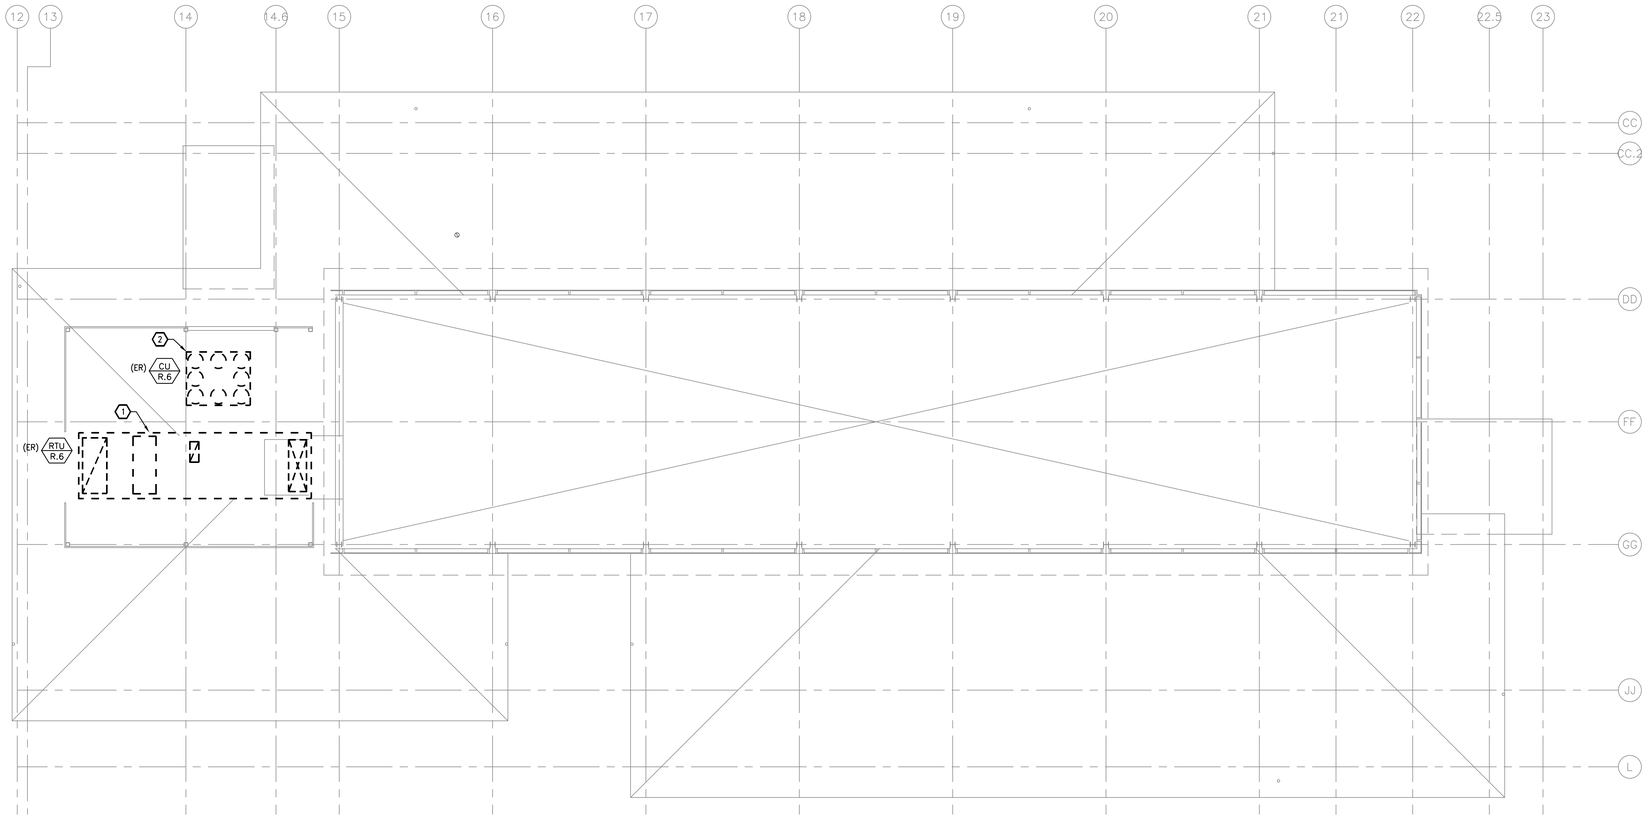

1 / E1.3 **ELECTRICAL DEMOLITION ROOF PLAN**

SCALE: 1/8" = 1'-0"

SHEET NOTES

1. COORDINATE WITH ARCHITECTURAL PLANS FOR ADDITIONAL DEMOLITION SCOPE OF WORK INFORMATION.
2. MAINTAIN ELECTRICAL SERVICE CONTINUITY FOR DEVICES OUTSIDE OF DEMOLITION SCOPE OF WORK DURING DEMOLITION.
3. EXISTING INFORMATION SHOW IS BASED ON EXISTING AS-BUILT DRAWINGS. CONTRACTOR TO FIELD VERIFY EXACT SITE CONDITIONS AND REPORT ANY DISCREPANCY TO THE DESIGN TEAM PRIOR TO ANY WORK.

KEYED NOTES

1. EXISTING MECHANICAL EQUIPMENT TO BE DISCONNECTED AND REMOVED. EXISTING WIRING TO BE REUSED AND EXTEND TO NEW MECHANICAL EQUIPMENT LOCATION. SEE DETAIL 1/E2.3 FOR LOCATION.
2. EXISTING MECHANICAL EQUIPMENT TO BE DISCONNECTED AND REMOVED ALONG WITH ALL ASSOCIATED WIRING. EXISTING CONDUIT TO REMAIN AND REUSED FOR NEW WIRE TO NEW EQUIPMENT. SEE SHEET E0.1 AND E2.3 FOR ADDITIONAL INFORMATION.

MAZZETTI
121 SW Salmon St., Suite 1000
Portland, OR 97204-2918
Tel: 503.620.3232
www.mazzetti.com

Project Number: 005-600420

EXPIRES: 12/31/22
REGISTERED PROFESSIONAL ENGINEER
70,860
OREGON
JULY 11, 2008
TOM E. RITENOUR

REVISIONS

NO.	DATE	DESCRIPTION
.	.	.

ARCHITECTS PROJECT #

CLIENT PROJECT #

CLIENT ACCOUNT #

PROJECT TITLE

CLACKAMAS COMMUNITY COLLEGE
WILSONVILLE TRAINING CENTER
RTU-6 REPLACEMENT

SHEET TITLE ~~ELECTRICAL DEMOLITION~~ ROOF PLAN

SCALE 1/8"=1'-0"

DATE 08-29-2022

SHEET NO. E1.3

M:\Portland\Projects\21\005-600420 - CCC Wilsonville Training Center RTU #6\04 Dwgs\Dwg\E1.3 Electrical Demolition Roof Plan.dwg - W1.3 - jpate - Aug 26, 2022 - 2:32pm