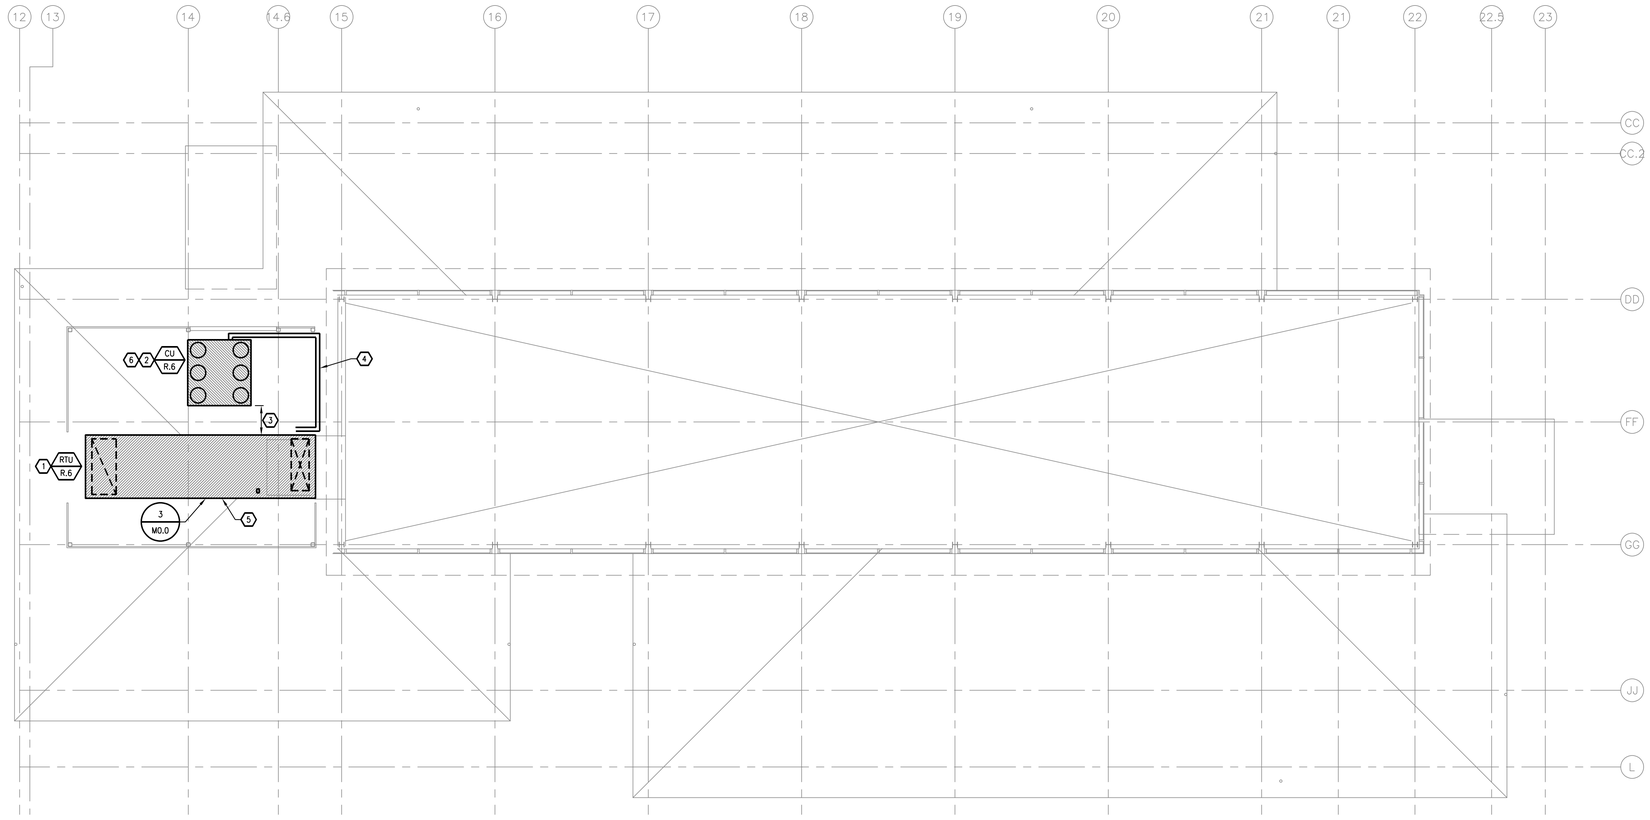

KEYED NOTES

1. LOCATE NEW ROOFTOP UNIT ON EXISTING CURB. RECONNECT EXISTING DUCTWORK TO NEW UNIT; REUSE IN-CURB DUCT SILENCER.
2. LOCATE NEW CONDENSING UNIT ON NEW SLEEPERS. SEE DETAIL 1/M0.0 AND 2/M0.0.
3. MAINTAIN MINIMUM 46-INCHES BETWEEN EDGE OF CONDENSING UNIT AND EDGE OF ROOFTOP UNIT.
4. INSTALL NEW REFRIGERANT PIPING BETWEEN CONDENSING UNIT AND ROOFTOP UNIT. INSTALL PER MANUFACTURER'S REQUIREMENTS.
5. RECONNECT GAS PIPING TO ROOFTOP UNIT.
6. PATCH AND REPAIR ASPHALT ROOF TO FACILITATE INSTALLATION OF NEW CONDENSING UNIT ANCHORAGE TO STRUCTURE.

1 / M2.3 **MECHANICAL ROOF PLAN**

SCALE: 1/8" = 1'-0"

N

MAZZETTI
121 SW Salmon St., Suite 1000
Portland, OR 97204-2918
Tel: 503.620.3232
www.mazzetti.com

Project Number: 005-600420

REGISTERED PROFESSIONAL ENGINEER
M.ELTE
Digitally Signed
OREGON
JULY 15, 1982
TIMOTHY S. ELY
EXPIRES 12/31/23

REVISIONS

NO.	DATE	DESCRIPTION
.	.	.

ARCHITECTS PROJECT #

CLIENT PROJECT #

CLIENT ACCOUNT #

PROJECT TITLE

CLACKAMAS COMMUNITY COLLEGE
WILSONVILLE TRAINING CENTER
RTU-6 REPLACEMENT

SHEET TITLE

MECHANICAL ROOF PLAN

SCALE	DATE
1/8"=1'-0"	08-29-2022

SHEET NO.

M2.3

M:\Portland\Projects\127\005-600420 - CCC Wilsonville Training Center RTU #6\04 Dwgs\Mech\M2.3 Mechanical Roof Plan.dwg - M2.3 - dward - Aug 26, 2022 - 2:46pm